



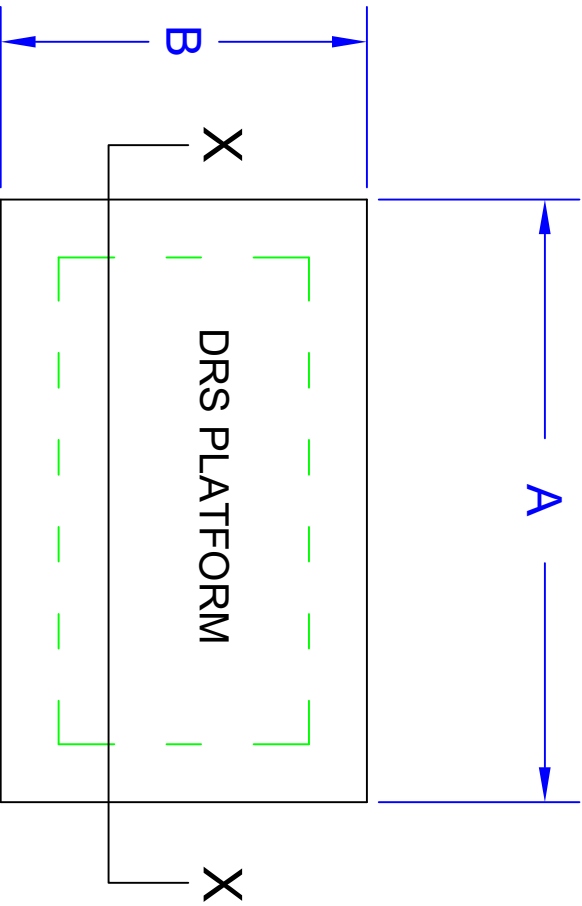

PLAN

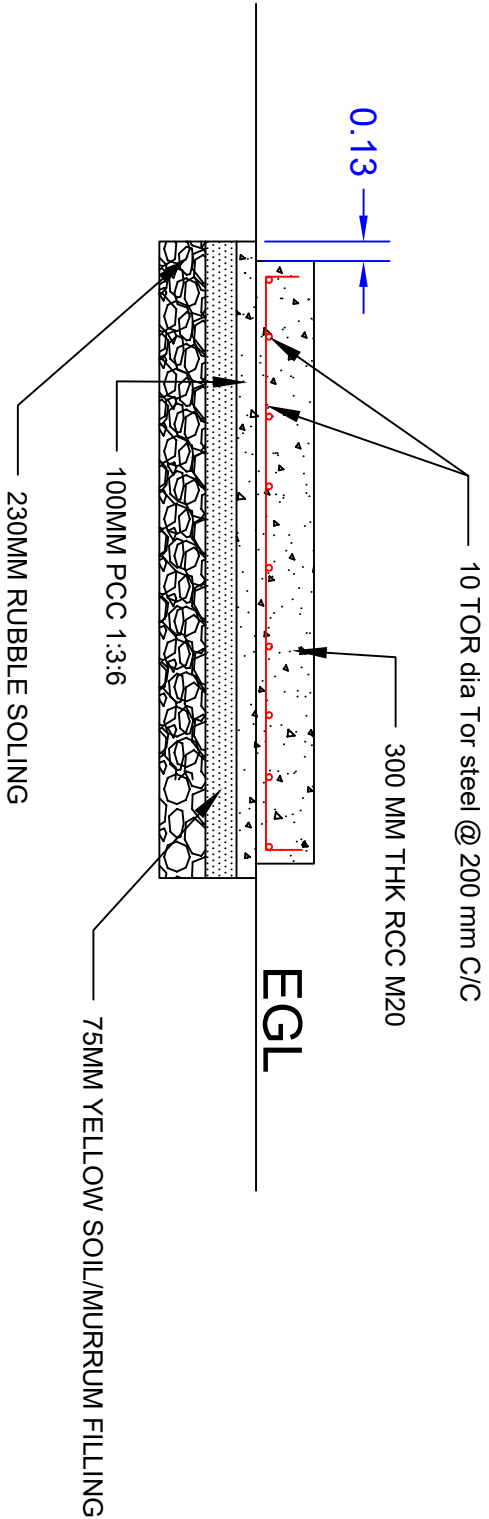

SECTION - "X-X"

Sl. No.	Make	Capacity (SCMH)	Length of RCC foundation (mm) A	Width of RCC foundation (mm) B
1	Nirmal	500	4650	2000
2	Nirmal	1000	4500	2100
3	Nirmal	2000	5275	2400
4	Nirmal	5000	6200	2400
5	Autometers	500	5100	2400
6	Autometers	1000	5100	2400
7	Autometers	5000	6200	2400
8	Emerson	5000	6400	2900

NOTE:

- 1) ALL SHRUBS, PLANTS & VEGETATION (IF ANY) SHOULD BE REMOVED
- 2) FIRM STRATA SHOULD BE MADE AS A SUB BASE FOR CONCRETE PLATFORM
- 3) BASE OF THE CONCRETE SHOULD BE WELL COMPACTED
- 4) RCC SHOULD BE DONE WITH 1:1.5:3 PROPORTION
- 5) PROPER SHUTTERING SHOULD BE DONE WITH WOODEN PLANKS/MS PLATE:
- 6) THERE SHOULD NOT BE ANY SLOPE ON THE PLATFORM TOP SURFACE
- 7) THE VALUES FOR "A" AND "B" SHALL BE REFERRED FROM THE TABLE BASED ON CAPACITY AND MAKE

NOTE : ALL DIMENSIONS ARE IN METER UNLESS SPECIFIED



GUJARAT GAS LIMITED

PROPOSED A/G DRS FOUNDATION DESIGN

SCALE	SHEET	DRAWING NO	REV
NTS	1 OF 1	GGL/SRT//C/M/L/2017/01	01